


Path: T:\GIS\Projects\Statewide PFAS\Dillingham\2023 Report\figs saved in wrong spot\2023 Reporting Figures\2023 results quarterly.mxd - Author: User-ARM Date: 1/16/2024

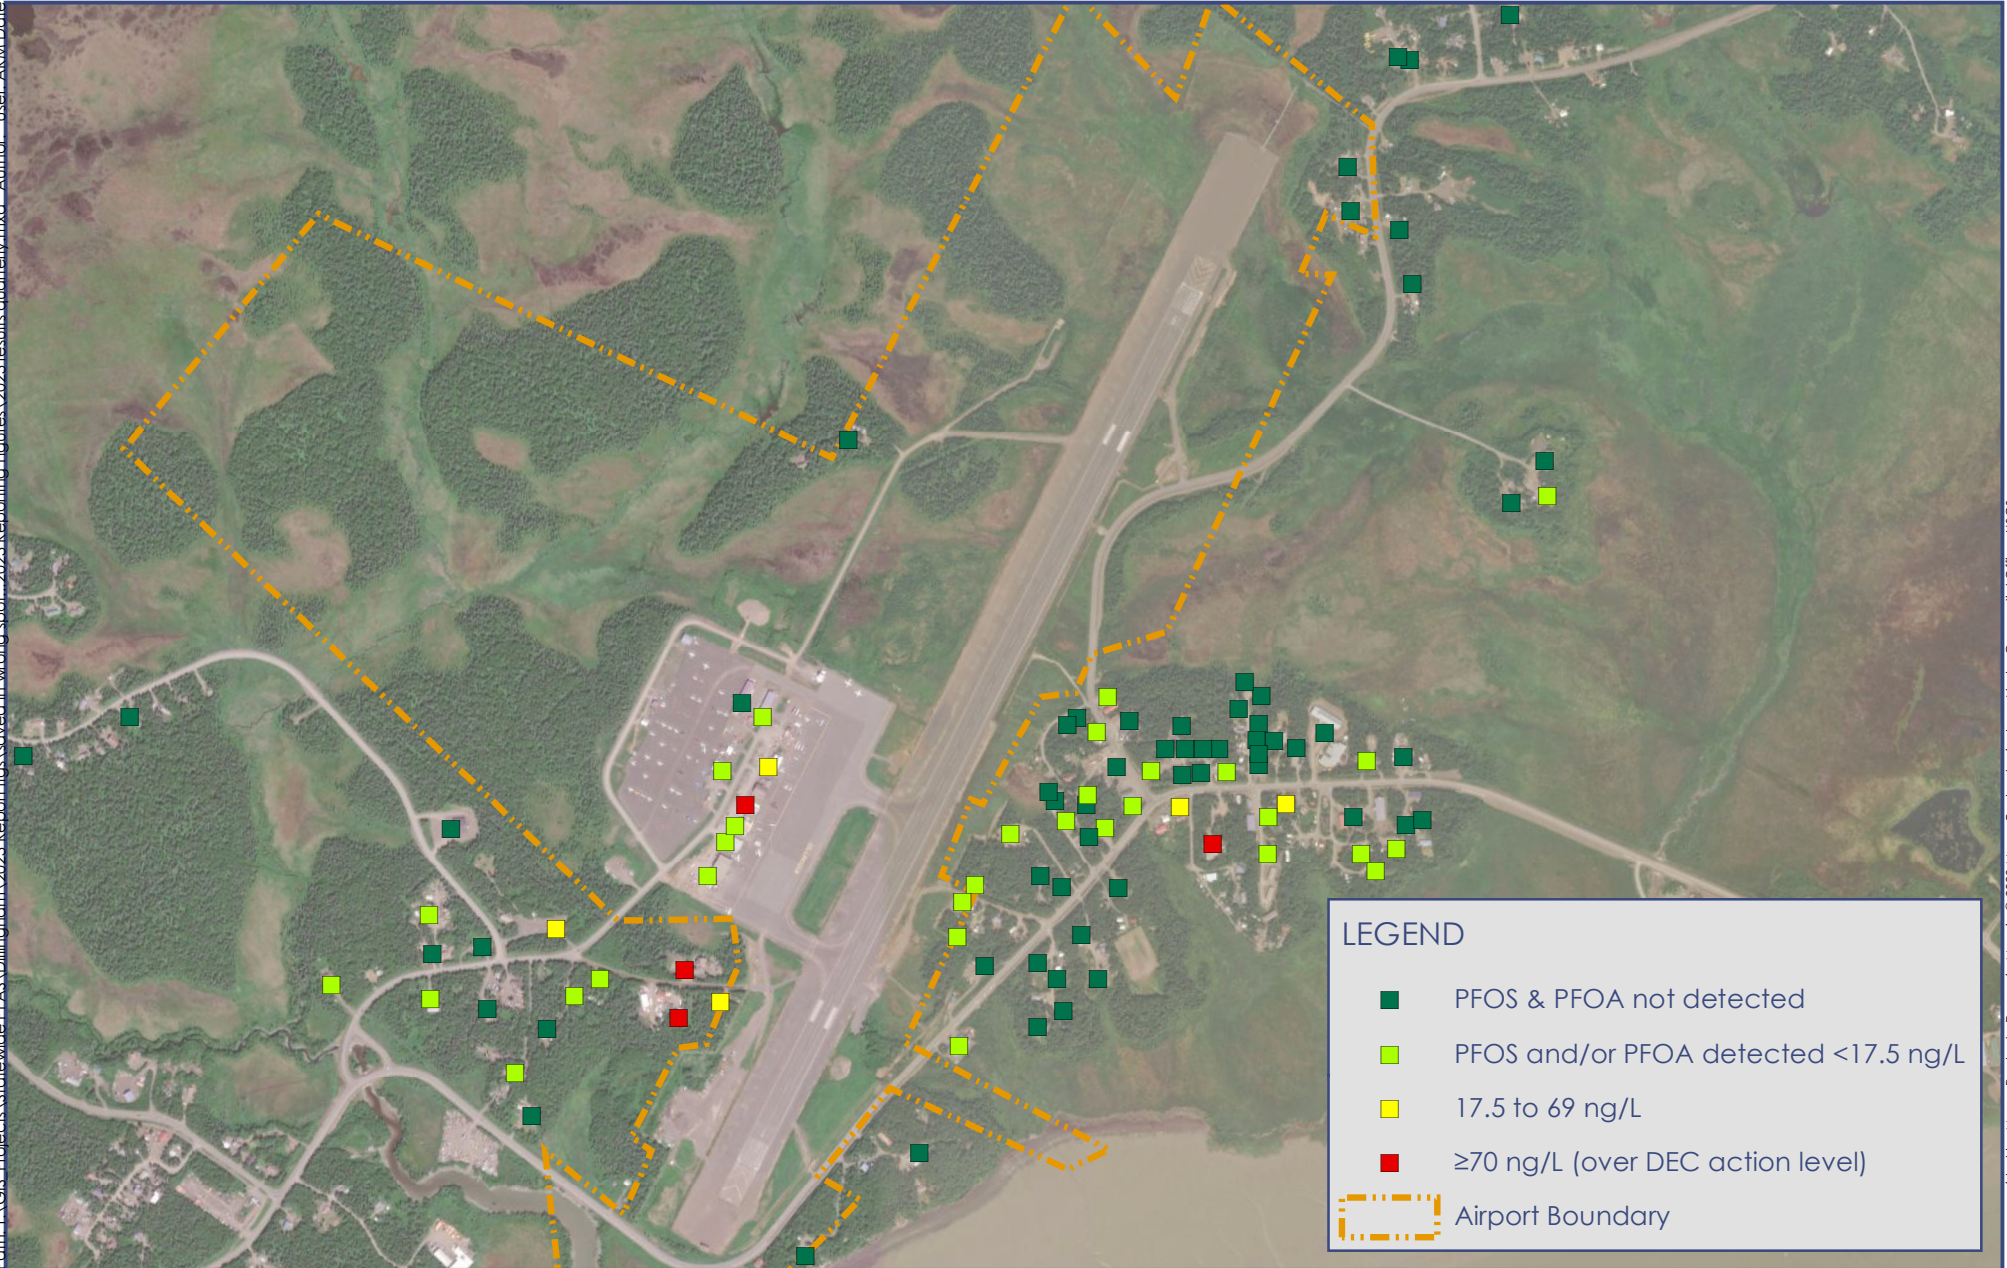

LEGEND

- PFOS & PFOA not detected
- PFOS and/or PFOA detected <17.5 ng/L
- 17.5 to 69 ng/L
- ≥70 ng/L (over DEC action level)
- Airport Boundary

Notes:

1. Samples collected through July 2023.
2. Current DEC action level is 70 ng/L for the sum of PFOS + PFOA.
3. Locations of water supply wells are approximate.

ng/L= nanograms per liter

March 2024

**HIGHEST REPORTED PFOS + PFOA RESULT
 WATER SUPPLY WELL MONITORING**

Figure 3

Imagery provided by Maxar Products; Dynamic; Mosatle © 2020 Maxar Technologies Inc.; Alaska Geospatial Office; USGS